



**CITY OF BELLEVUE  
SIDEWALK/CURB CONSTRUCTION  
PERMIT APPLICATION  
616 POPLAR STREET  
BELLEVUE, KENTUCKY 41073  
PHONE: 859-431-8866 FAX: 859-261-8387**

Property owner's name: \_\_\_\_\_

Address: \_\_\_\_\_

Phone #: \_\_\_\_\_

Contractor's name: \_\_\_\_\_

Address: \_\_\_\_\_

Phone #: \_\_\_\_\_ Occupational License #: \_\_\_\_\_

Description of work: \_\_\_\_\_

Estimated date for excavation: \_\_\_\_\_

Estimated date for pouring: \_\_\_\_\_

**Reimbursement for curb is \$4.00 per linear foot. Failure to receive the below approvals will result in the property owner forfeiting his/her rights of any reimbursement from the City's Curb Replacement Program.**

**FOR OFFICE USE ONLY**

Permission to begin work: \_\_\_\_\_

Building Inspector (431-8866)

Date

Excavation inspection: \_\_\_\_\_

Building Inspector (431-8866)

Date

Final inspection: \_\_\_\_\_

Building Inspector (431-8866)

Date

Linear feet: \_\_\_\_\_ X \$4.00 = \_\_\_\_\_

## **CITY OF BELLEVUE**

### Curb Replacement Policy

In an effort to maintain the environment of our community, the city will share in the cost of curb replacement with a property owner.

The city will pay one-half of the cost but no more than \$4.00 per linear foot.


Steps for reimbursement from the city are as follows:

1. Submit two contractor bids to the office of the City Clerk with a request that the City pay half based on the lowest bid. A contractor must have an occupational license to work in the City.
2. You will be notified to proceed and the Public Works Director will inspect the job.
3. When the job is satisfactorily completed present proof of payment to the City Clerk and you will be reimbursed.

**CITY OF BELLEVUE  
SPECIFICATIONS FOR IMPROVING SIDEWALKS**

1. SUB-GRADE: The sub-grade will be brought to an even compact surface four (4) inches below the proposed finished surface of the pavement. Soft, spongy earth, vegetation or other perishable matter shall be removed. The space shall be filled with gravel or broken stone and thoroughly compacted.
2. CONCRETE MATERIAL:  
  
Strength: 4,000 P.S.I. 28-day test air entrainment  
Thickness: a) sidewalks - 4 inches  
              b) driveways - 6 inches  
  
Rebar or road mesh not required.
3. TOP SURFACE: The surface shall be spread and floated smooth, and troweled to a hard smooth surface. No sidewalk or driveway surface painting or color-coding shall be acceptable to the City.
4. BLOCKING: The surface of the sidewalk shall be cut into blocks with a wedge-shaped tool, leaving a groove five-eighths inch in depth, one-eighth inch at the bottom, and one-fourth inch at the top. Top edge of groove to be slightly rounded. A broom finish is recommended to provide a non-slip surface.
5. EXPANSION: Expansion joints shall be placed 15 feet in sidewalks and at the ends of sidewalks being replaced.
6. GRADE OF SIDEWALK: In full width sidewalks, the pavement shall begin even with the grade of the curb and rise at a rate of three-eighths inch per foot to the property line. The alignment and slope of all sidewalks less than the full width of sidewalk will be subject to the special direction of the City Building Inspector. All cellar doors, sills, stop cock boxes, or other fixtures shall be flush with the sidewalk being replaced.
7. Membrane curing compound is recommended to prevent cracking.
8. CURBING: Where curbing is to be replaced, the existing curbing shall be removed completely. The new curbing shall be six inches high above the pavement of the street, six inches wide, and extend into the ground six inches.
9. HANDICAP RAMPS: When replacing corner sidewalks, handicap ramps shall be installed per Kentucky Building Code specifications.
10. All old material taken from sidewalks and all surplus material from the work must be removed immediately and disposed of properly.

11. **CONCRETE CURING:** The contractor will be responsible to oversee the work until such time that it has cured to ensure that the finish is maintained. Failure on the part of the contractor to abide by this regulation could result in orders to remove and replace any sections that become damaged prior to curing.
12. If a curb is poured with the sidewalk, a six inch curbing trowel must be used to form the edge of the curb.

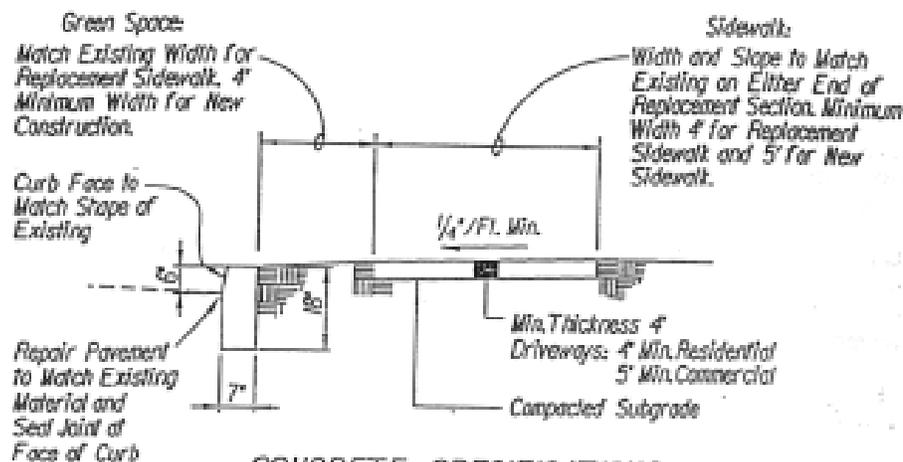

**CONCRETE SPECIFICATIONS:**

Concrete Strength 4000 psi at 28 Days  
 Air Entrainment 6% ± 1%

**NOTES:**


Joints Shall be Replaced in Kind as Either Construction/Expansion Joints or Contraction Joints.

Joint Spacing Shall Match Existing With Maximum Spacing not to Exceed 5 Feet.

**SIDEWALK AND CURB REPLACEMENT DETAIL**

*City of Bellevue, Ky*

NOTES:  
1) HANDICAP RAMPS REQUIRED AT INTERSECTIONS.

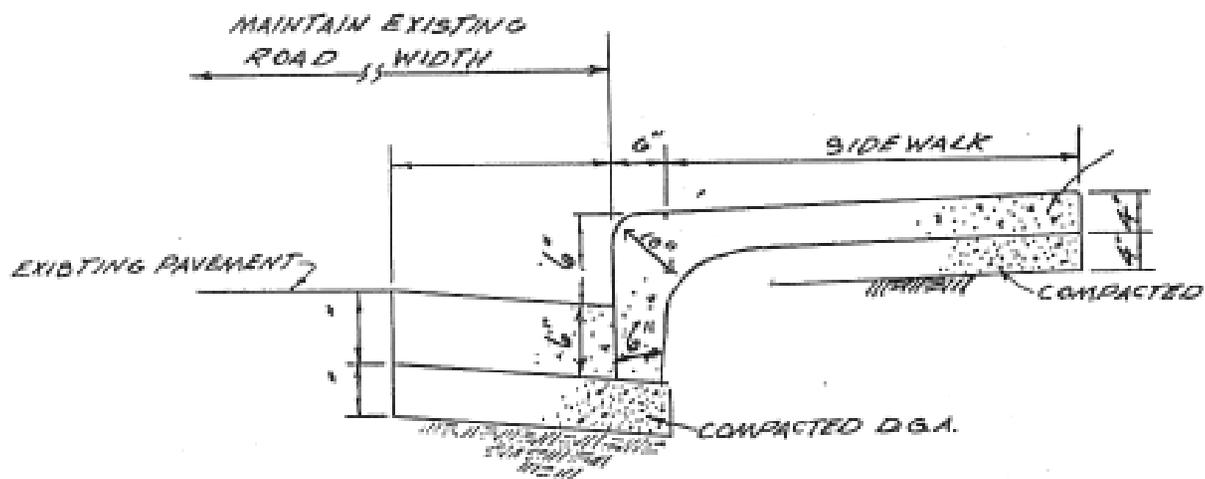

SECTION " SIDEWALK CURB & GUTTER

K.T.S.